Figure S37
30 October 2013
8003 nozzles
Village
I hr mortality
Outdoors IN BOX

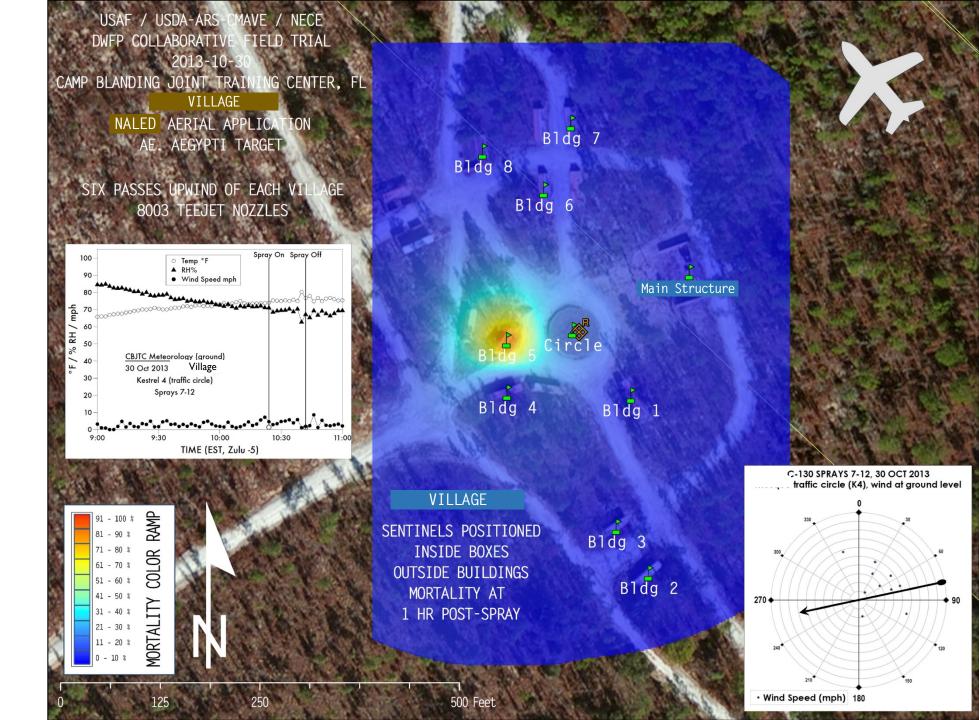


Figure S38
30 October 2013
8003 nozzles
Village
4 hr mortality
Outdoors IN BOX

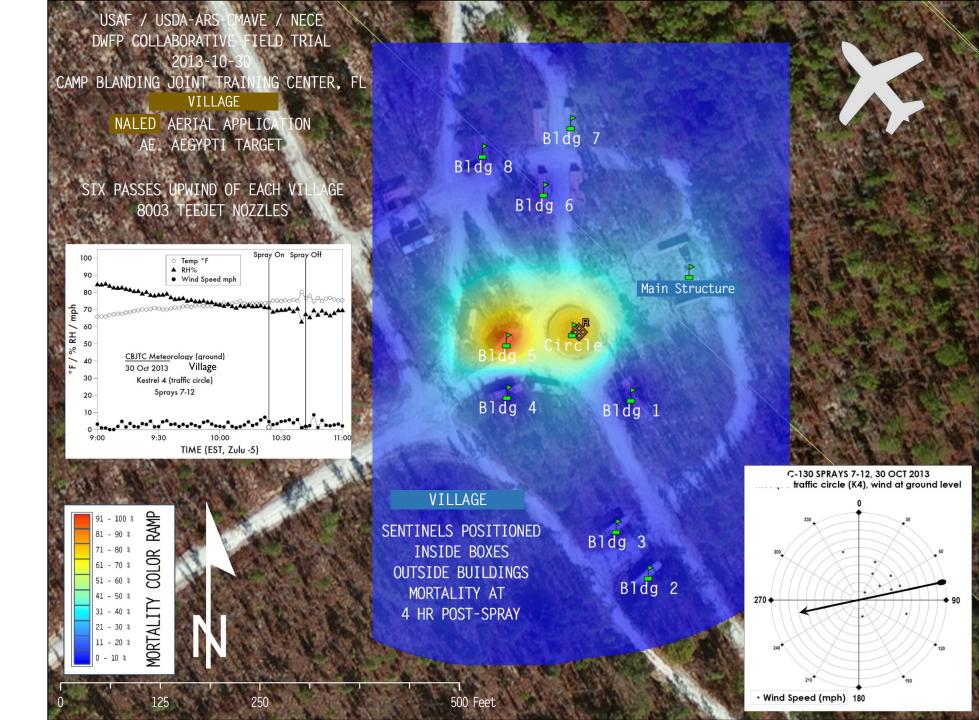


Figure S39
30 October 2013
8003 nozzles
Village
12 hr mortality
Outdoors IN BOX

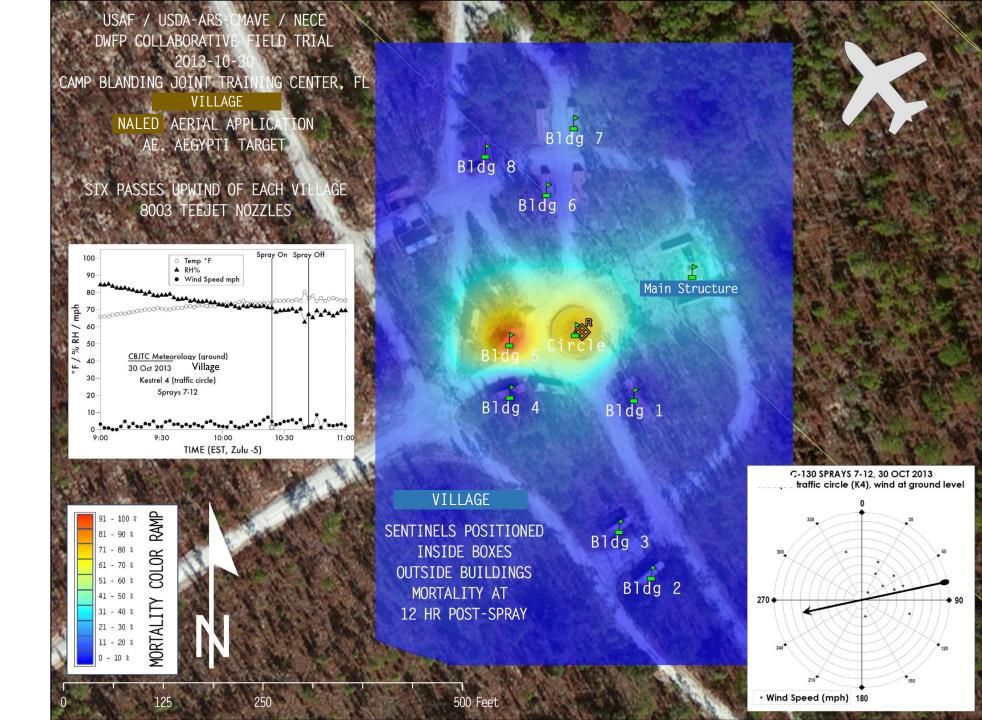


Figure S40
30 October 2013
8003 nozzles
Village
I hr mortality
Outdoors ON POLE

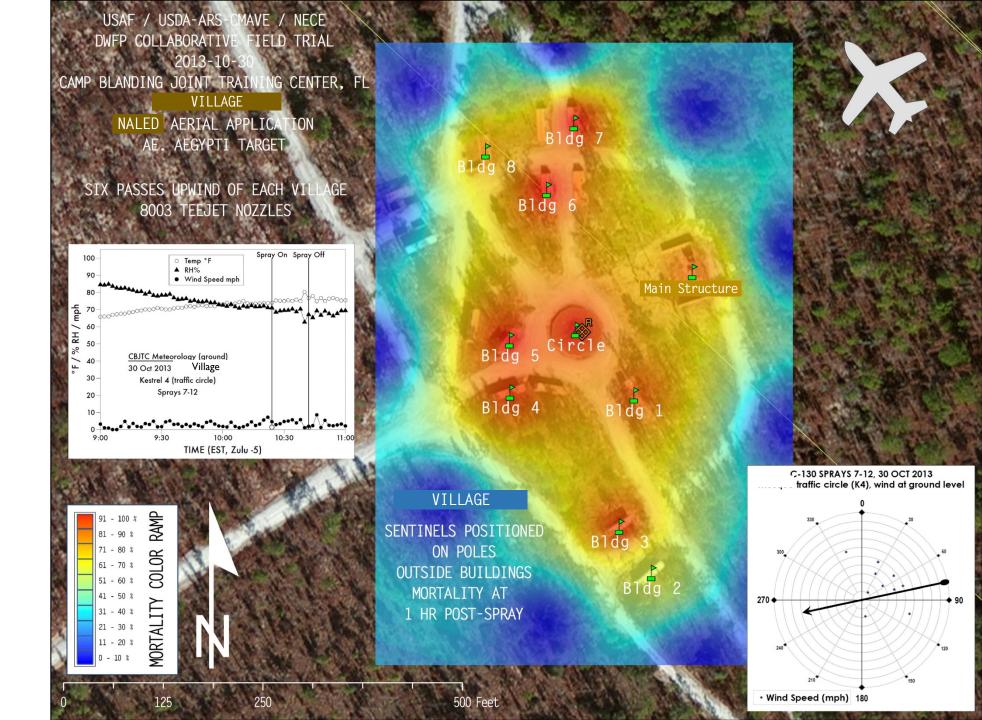


Figure S41
30 October 2013
8003 nozzles
Village
4 hr mortality
Outdoors ON POLE

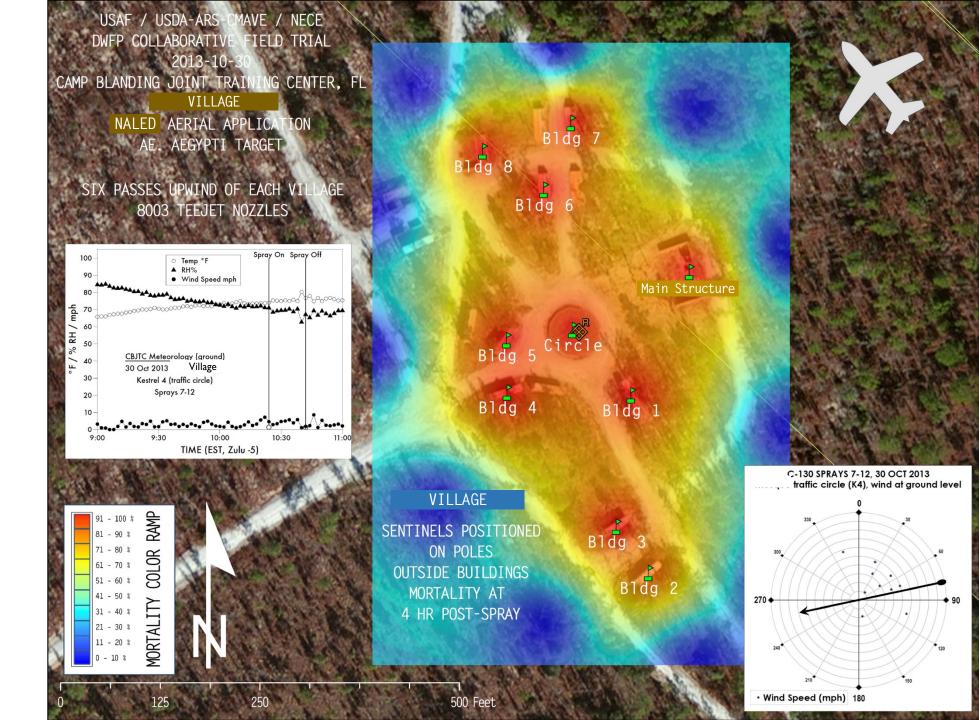


Figure S42
30 October 2013
8003 nozzles
Village
12 hr mortality
Outdoors ON POLE

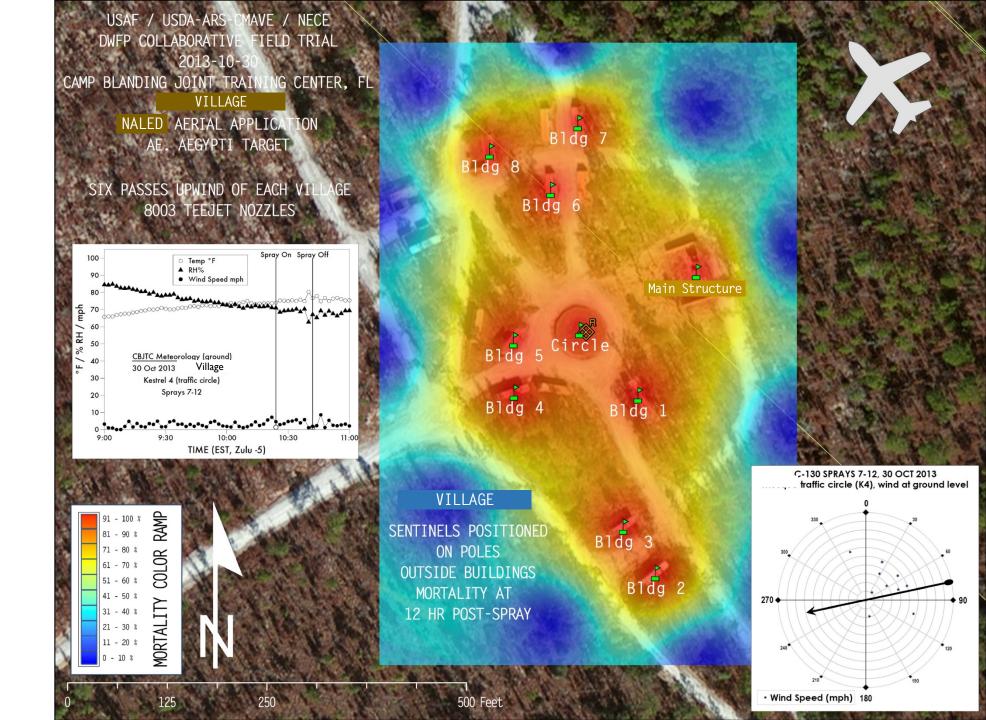


Figure S43
30 October 2013
8003 nozzles
Village
I hr mortality
Indoors IN BOX

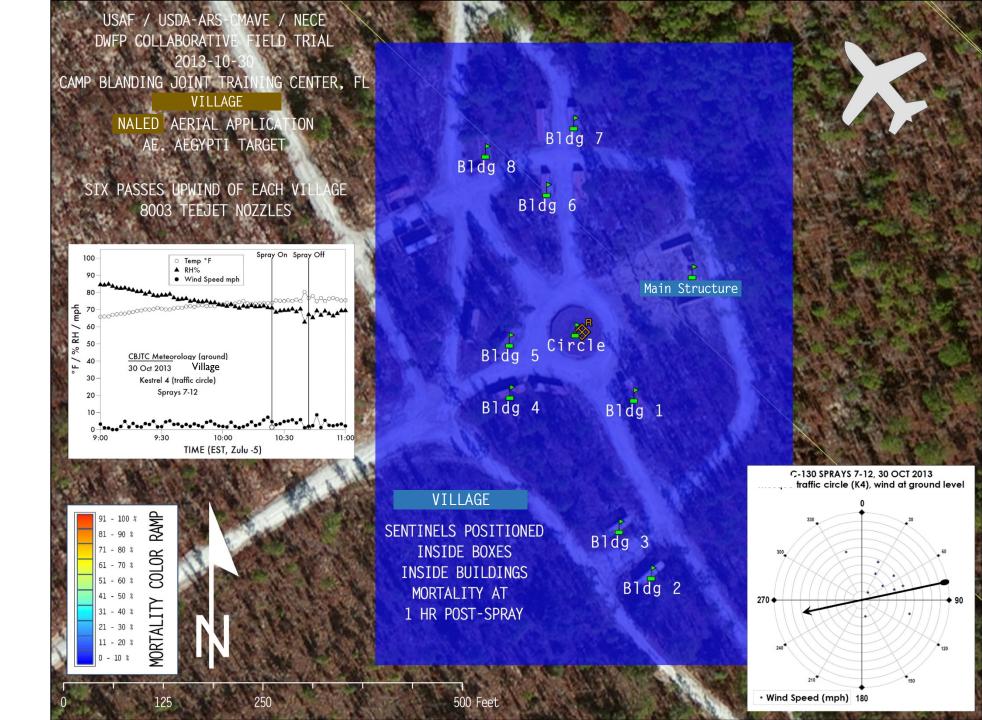


Figure S44
30 October 2013
8003 nozzles
Village
4 hr mortality
Indoors IN BOX

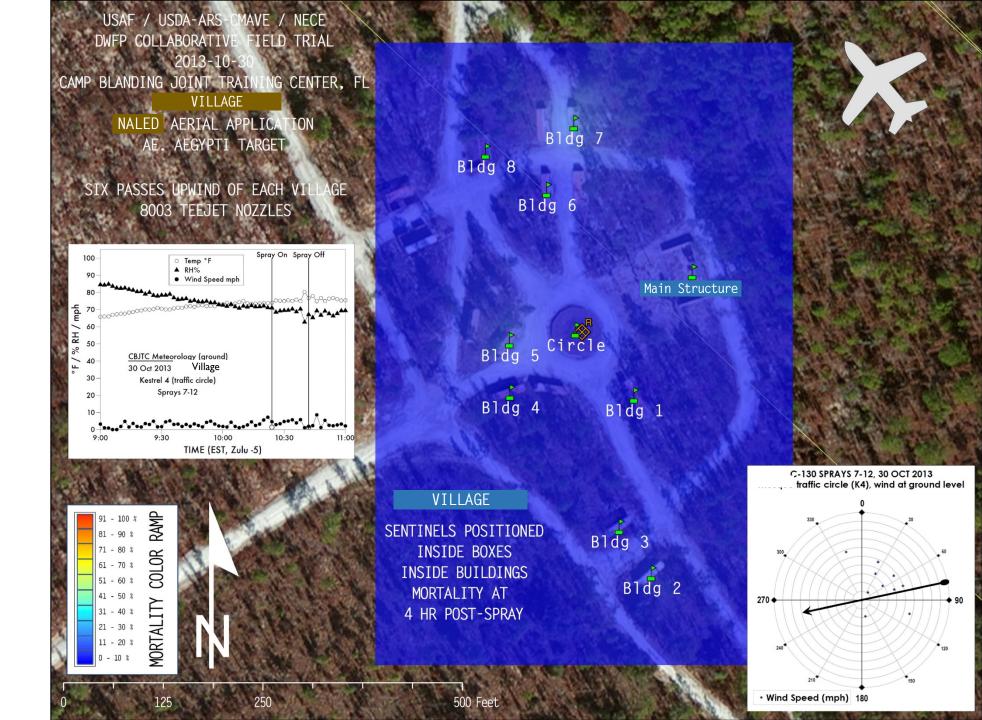


Figure S45
30 October 2013
8003 nozzles
Village
12 hr mortality
Indoors IN BOX

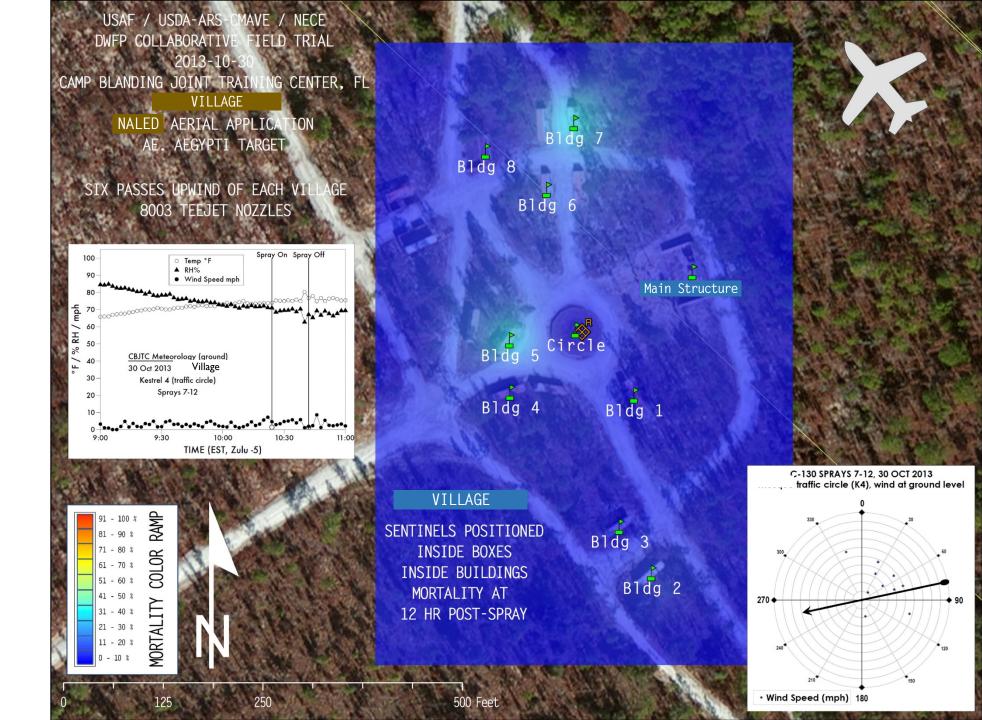


Figure S46
30 October 2013
8003 nozzles
Village
I hr mortality
Indoors ON FLOOR

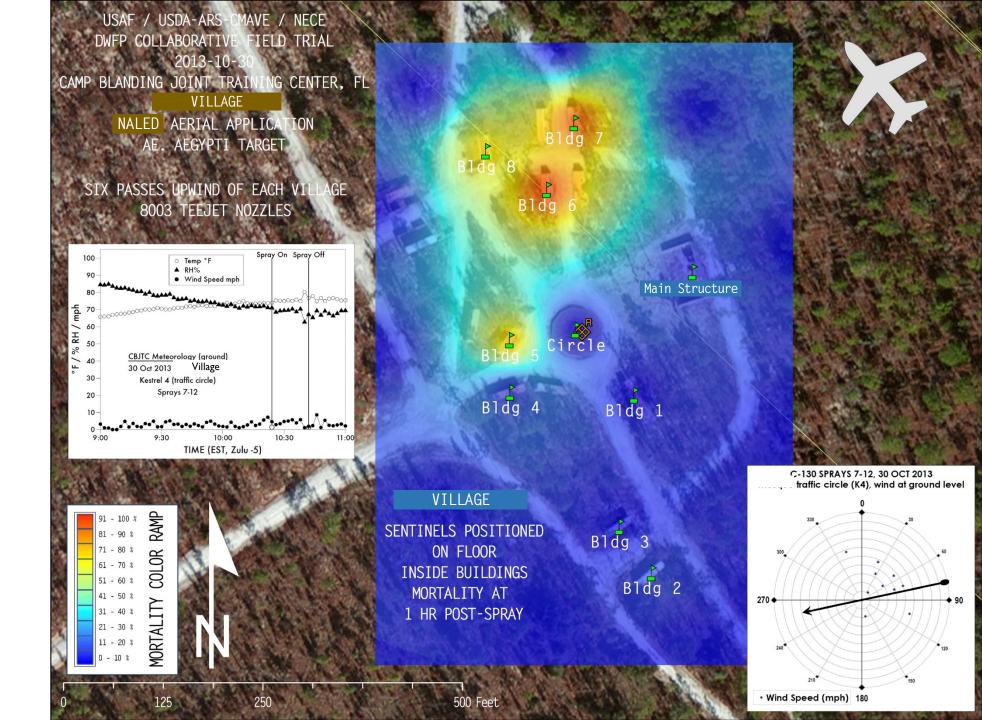


Figure S47
30 October 2013
8003 nozzles
Village
4 hr mortality
Indoors ON FLOOR

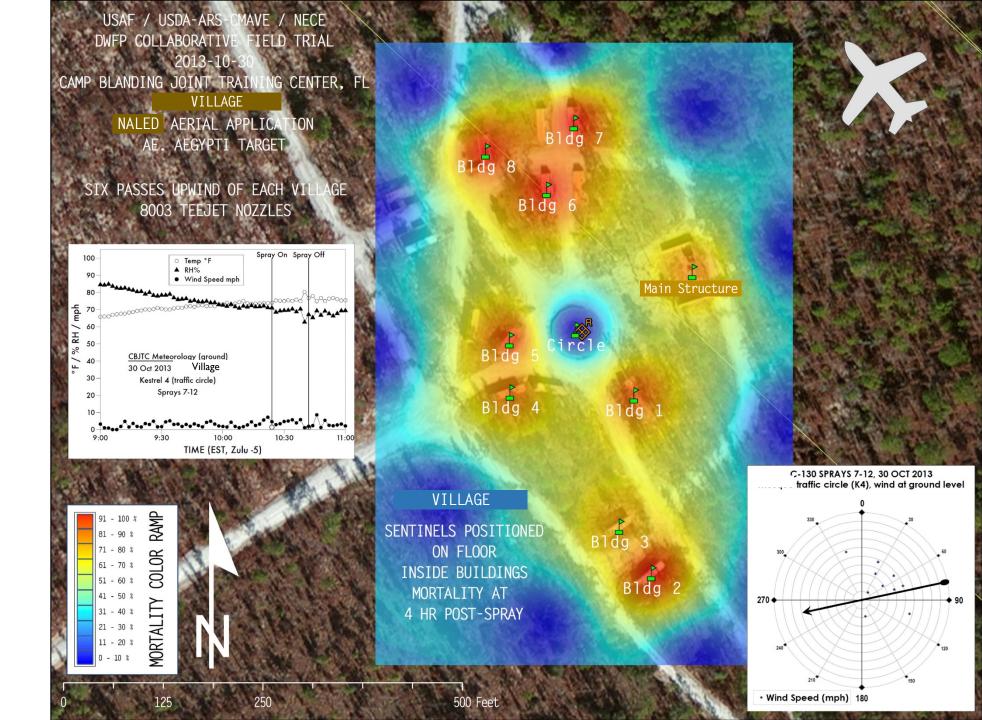


Figure S48
30 October 2013
8003 nozzles
Village
12 hr mortality
Indoors ON FLOOR

